



Electricity Licence



Electricity Generation Licence

HWF 2 Pty Ltd

ACN 605 944 394

Issued by the Essential Services Commission on 13 February 2017.
Last varied by the Essential Services Commission on 16 October 2019.

Variation history

Amendment number	Variation date	Reason	
ESCOSA01	16 October 2019	Licence varied to reflect amendments to the Act.	

1 Definitions and interpretation

- 1.1 Words appearing in bold like **this** are defined in Part 1 of the Schedule.
- 1.2 This licence must be interpreted in accordance with the rules set out in Part 2 of the Schedule.

2 Grant of licence

- 2.1 The **licensee** is licensed under Part 3 of the **Act**, and subject to the conditions set out in this licence, to generate electricity:
- a) using the **electricity generating plant** as specified in Part A of the Annexure; and
 - b) at the location described in Part B of the Annexure.

3 Term

- 3.1 This licence commences on the date it is issued and continues until it is:
- a) surrendered by the **licensee** under section 29 of the **Act**; or
 - b) suspended or cancelled by the **Commission** under section 37 of the **Act**.

4 Fees

- 4.1 The **licensee** must pay the applicable licence fees in accordance with section 20 of the **Act**.

5 Access

- 5.1 The **licensee** must:
- a) in accordance with, and to the extent required by, the **Electricity Transmission Code**, grant to a **network service provider**, rights to use, or have access to, those parts of the **licensee's electricity generating plant** that are interconnected or interface with the **network service provider's** assets for the purpose of ensuring the proper integrated operation of the South Australian power system and the proper conduct of the operations authorised by the **network service provider's transmission licence** or **distribution licence**; and
 - b) in the absence of agreement as to the terms on which such rights are to be granted, comply with a determination of the **Commission** as to those terms.

6 Dispute resolution

- 6.1 A dispute relating to the granting of rights to use or have access to the interconnecting assets of the **licensee's electricity generating plant** referred to in clause 5 shall be resolved in accordance with any applicable **industry code** developed by the **Commission** for the resolution of disputes.
- 6.2 Clause 6.1 does not apply to the extent the dispute is subject to resolution in accordance with or under the **National Electricity Rules**.

7 Compliance with Codes

7.1 The licensee must:

- a) comply with all applicable provisions of the Electricity Transmission Code, the Electricity Distribution Code and the Electricity Metering Code;
- b) comply with all applicable provisions of any other industry code or rule made by the Commission from time to time; and
- c) notify the Commission if it commits a material breach of the Electricity Transmission Code, the Electricity Distribution Code or the Electricity Metering Code within 3 days after becoming aware of that breach.

8 Safety reliability, maintenance and technical management plan

8.1 The licensee must:

- (a) prepare, maintain and periodically revise a safety, reliability, maintenance and technical management plan dealing with matters prescribed by regulation;
- (b) obtain the approval of the Technical Regulator:
 - (i) to the plan (prior to commencement of the operation of the electricity generating plant to which the plan relates); and
 - (ii) to any revision of the plan;
- (c) comply with the plan as approved from time to time in accordance with clause 8.1(b); and
- (d) undertake audits of its compliance with the plan from time to time and report the results of those audits to the Technical Regulator, in the form required by the Technical Regulator.

9 National electricity market

9.1 Subject to clause 9.2, licensee must hold and comply with the conditions of any registration required under the National Electricity Rules granted by AEMO (or the person responsible for the granting of such registrations under the National Electricity Law or the National Electricity Rules) at all times that such registration is required for the operations authorised by this licence.

9.2 In respect of the electricity generating plant which the licensee is authorised to operate under this licence, the licensee:

- a) must obtain registration as a market generator under the National Electricity Rules; and
- b) must not apply for any generating unit within that electricity generating plant to be classified as a non-scheduled generating unit under the National Electricity Rules.

10 Provision of Frequency Control Ancillary Services

- 10.1 In respect of the electricity **generating plant** which the **licensee** is authorised to operate under this licence, the **licensee** must, following a request from the **Commission** in writing:
- a) register as an ancillary service **generating unit** in accordance with clause 2.2.6 of the **National Electricity Rules**, for the provision of **frequency control ancillary services**; and
 - b) comply with dispatch instructions issued via the **Automatic Generator Control System** in accordance with clause 3.8.21 of the **National Electricity Rules**; and
 - c) comply with the terms of a **frequency control ancillary services** program trial, as prescribed by the **Commission**.

11 Response to frequency disturbances

- 11.1 Each **generating unit** which the **licensee** is authorised to operate under this licence must comply with:
- a) the **automatic access standard** for generating system capability for continuous uninterrupted operation for frequencies specified in clause S5.2.5.3 of the **National Electricity Rules**; and
 - b) the **minimum access standard** for generating system capability for continuous uninterrupted operation for frequencies specified in clause S5.2.5.3(a) of the **National Electricity Rules**.

12 Fault ride through capability

- 12.1 Each **generating unit** which the **licensee** is authorised to operate under this licence must comply with:
- a) the **automatic access standard** for generating system response to disturbances following contingency events specified in clause S5.2.5.5(b)(1) of the **National Electricity Rules**; and
 - b) subject to clause 12.2, the **automatic access standard** for generating system response to disturbances following contingency events specified in clause S5.2.5.5(b)(2) of the **National Electricity Rules**; and
 - c) subject to clause 12.3, the **automatic access standard** for generating system response to voltage disturbances specified in clauses S5.2.5.4 of the **National Electricity Rules**.
- 12.2 The **licensee** is not required to comply with clause 12.1(b) in respect of a **generating unit** which the **licensee** is authorised to operate under this licence where:
- a) the minimum access standard requirements specified in clause S5.2.5.5(c)(2) of the **National Electricity Rules** in relation to generating system response to disturbances following contingency events; and
 - b) the requirements of clauses S5.2.5.5(d), (e) and (f) of the **National Electricity Rules**, are satisfied in respect of that **generating unit**.

- 12.3 The licensee is not required to comply with clause 12.1(c) in respect of a **generating unit** which the licensee is authorised to operate under this licence where:
- a) AEMO and the relevant **network service provider** have agreed, pursuant to clause S5.2.5.4(c)(3) of the **National Electricity Rules**, that there would be no material adverse impact on the quality of supply to other network users or power system security as a result of that non-compliance; and
 - b) the requirements of clauses S5.2.5.4(c), (d), (e) and (f) of the **National Electricity Rules** are otherwise satisfied in respect of that **generating unit**.

13 Reactive power capability

- 13.1 The **electricity generating plant** operated by the licensee must at all times be capable of continuous operation at a power factor of between 0.93 leading and 0.93 lagging at real power outputs exceeding 5MW at the connection point.
- 13.2 The **electricity generating plant** operated by the licensee must at all times be capable of providing:
- a) subject to clause 13.4(b), at least 50 percent of the reactive power required to meet the power factor referred to in clause 13.1 on a dynamically variable basis; and
 - b) the balance of the reactive power required to meet the power factor referred to in clause 13.1 on a non-dynamic basis.
- 13.3 At generation levels below full rated output the **electricity generating plant** operated by the licensee must be capable of:
- a) absorbing reactive power at a level at least pro-rata to that of full output; and
 - b) delivering reactive power at a level at least pro-rata to that of full output.
- 13.4 For the purposes of clause 13.2(a):
- a) dynamically variable means continuous modulation of the reactive power output over its range, with an initial response time or dead time of less than 200 milliseconds and a rise time (as defined in clause S5.2.5.13 of the **National Electricity Rules**) of less than 1 second following a voltage disturbance on the network; and
 - b) for a period of not more than 2 seconds on any single occasion, a short-term overload capability may be used to meet the 50 percent requirement, provided that use of that short-term overload capability does not cause a breach of any other licence condition.
- 13.5 The reactive power capability of the **electricity generation plant** operated by the licensee must be capable of control by a fast-acting, continuously variable, voltage control system which is able to receive a local and remote voltage set point.
- 13.6 The **electricity generating plant** operated by the licensee must be able to operate at either a set reactive power, or a set power factor, which is able to be set locally or remotely at any time.
- 13.7 The power factor or reactive power control mode of the **electricity generating plant** operated by the licensee must be capable of:

- a) being overridden by voltage support mode during power system voltage disturbances; and
- b) automatically reverting to power factor or reactive power mode when the disturbance has ceased.

14 Wind forecasting

- 14.1 In the event that any **generating unit** which the **licensee** is authorised to operate under this licence is classified under the **National Electricity Rules** other than as a semi-scheduled **generating unit**, the **Licensee** must, on request, provide to **AEMO** or the **Commission**, accurate and verifiable wind energy forecasting data and temperature data, appropriately constructed wind energy conversion models, documents and other information concerning the operation of that **generating unit**.
- 14.2 Any data, models, documents and information requested under this clause must be provided in the manner and form and within the time frame specified by **AEMO** or the **Commission**.

15 Information to AEMO

- 15.1 The **licensee** must, following a request from **AEMO**, provide to **AEMO** such documents and information as **AEMO** may reasonably require for the performance of its functions under the **Act**.
- 15.2 The generating plant operated by the **licensee** must be:
- a) able to meet the requirements specified by **AEMO** from time to time for the real time supply of data on active and reactive power for at least 3 hours following total loss of supply at the connection point; and
 - b) capable of remote control by **AEMO**.
- 15.3 In the event that any **generating unit** which the **licensee** is authorised to operate under this licence is classified under the **National Electricity Rules** other than as a semi-scheduled **generating unit**, the **licensee** must provide **AEMO** with forecasts of expected generation output for the purposes of incorporation into pre-dispatch, medium term and long term Projected Assessment of System Adequacy data.

16 System controller

- 16.1 The **licensee** must comply with any directions given to it by the **System Controller**.

17 Information to the Commission

- 17.1 The **licensee** must, from time to time, provide to the **Commission**, in a manner and form determined by the **Commission**:
- a) details of the **licensee's** financial, technical and other capacity to continue the operations authorised by this licence; and
 - b) such other information as the **Commission** may require from time to time.
- 17.2 The **licensee** must notify the **Commission** of any changes to its **officers**, and (if applicable) major shareholders, within 30 days of that change.

18 Operational and compliance audits

- 18.1 The licensee must undertake periodic audits of the operations authorised by this licence and of its compliance with its obligations under this licence and any applicable industry codes in accordance with the requirements of any applicable guideline issued by the Commission for this purpose.
- 18.2 The licensee must also conduct any further audits at a frequency and in manner approved by the Commission.
- 18.3 The results of audits conducted under this clause must be reported to the Commission in a manner approved by the Commission.
- 18.4 The Commission may require the licensee to use an independent expert approved by the Commission to conduct audits under this clause.
- 18.5 The Commission may require the costs of using an independent expert approved by the Commission to conduct audits under this clause to be met by the licensee.

19 Confidentiality

- 19.1 The licensee must, unless otherwise required by law, this licence, an industry code, or the National Electricity Rules, comply with any rules made by the Commission from time to time relating to the use of information acquired by the licensee in the course of operating the business authorised by this licence.

20 Community service

- 20.1 The licensee must comply with the requirements of any scheme approved and funded by the Minister for the provision by the State of customer concessions or the performance of community service obligations by the electricity entities.

21 Compatibility

- 21.1 The licensee must not do anything to its electricity generating plant affecting the compatibility of its electricity generating plant with any distribution network or transmission network so as to prejudice public safety or the security of the power system of which the electricity generating plant forms a part.

22 Insurance

- 22.1 The licensee must undertake and maintain during the term of this licence insurance against liability for causing bush fires.
- 22.2 The licensee must provide to the Commission a certificate of the insurer or the insurance broker by whom the insurance was arranged (in a form acceptable to the Commission) to the effect that such insurance is adequate and appropriate, given the nature of the licensee's activities conducted under this licence and the risks associated with those activities.

23 Compliance with laws

- 23.1 The licensee must comply with all applicable laws including, but not limited to, any technical or safety requirements or standards contained in regulations made under the Act.

24 Switching Manual

24.1 The licensee must:

- (a) prepare and maintain an internal switching manual in accordance with the regulations;
and
- (b) comply with any other requirements relating to switching prescribed in the regulations.

25 Variation

25.1 This licence may only be varied in accordance with section 27 of the Act.

26 Transfer

26.1 This licence may only be transferred in accordance with section 28 of the Act.

This licence was issued by the Commission on 13 February 2017 and last varied by the Commission on 16 October 2019.

The COMMON SEAL of the)
ESSENTIAL SERVICES)
COMMISSION of South)
Australia was hereunto)
affixed by authority of the)
ESSENTIAL SERVICES)
COMMISSION and in the)
presence of:)



Brett House
Commissioner

16 October 2019
Date

Schedule: Definitions and Interpretation

Part 1 – Definitions

In this licence:

Act means the Electricity Act 1995 (SA).

AEMO means the Australian Energy Market Operator Ltd (ACN 072 010 327).

automatic access standard has the same meaning given to that term under the **National Electricity Rules**.

Automatic Generator Control System has the same meaning given to that term under the **National Electricity Rules**.

business day means a day on which banks are open for general banking business in Adelaide, excluding a Saturday or Sunday.

Commission means the Essential Services Commission established under the **ESC Act**.

distribution licence means a licence to operate a **distribution network** granted under Part 3 of the **Act**.

distribution network has the meaning given to that term under the **Act**.

Electricity Distribution Code means the code of that name made by the **Commission** under section 28 of the **ESC Act** which regulates connections to a **distribution network** and the supply of electricity by distributors.

electricity entity means a person who has been granted a licence under Part 3 of the **Act** to carry on operations in the electricity supply industry.

electricity generating plant includes all **generating units** and all other equipment involved in generating electrical energy authorised to be operated by the **licensee** under this licence.

Electricity Metering Code means the code of that name made by the **Commission** under section 28 of the **ESC Act** which regulates the installation, maintenance and testing of meters.

Electricity Transmission Code means the code of that name made by the **Commission** under section 28 of the **ESC Act**.

ESC Act means the Essential Services Commission Act 2002 (SA).

frequency control ancillary services has the same meaning given to that term under the **National Electricity Rules**.

generator means a holder of a licence to generate electricity granted under Part 3 of the **Act**.

generating unit means each individual unit producing electrical energy

industry code means any code made by the **Commission** under section 28 of the **ESC Act** from time to time.

licensee means HWF 2 Pty Ltd (ACN 605 944 394).

minimum access standard has the same meaning given to that term under the National Electricity Rules.

National Electricity Rules has the meaning given to that term in the National Electricity Law.

National Electricity Law means the National Electricity Law referred to in the National Electricity (South Australia) Act 1996 (SA).

network service provider means the holder of a distribution licence or a transmission licence (as the case may be) issued by the Commission under Part 3 of the Act.

rule means any rule issued by the Commission under section 28 of the ESC Act.

System Controller means the person licensed under Part 3 of the Act to exercise system control over a power system.

Technical Regulator means the person holding the office of Technical Regulator under Part 2 of the Act.

transmission licence means a licence to operate a transmission network granted under Part 3 of the Act.

transmission network has the meaning given to that term under the Act.

Part 2 - Interpretation

In this licence, unless the context otherwise requires:


- (a) headings are for convenience only and do not affect the interpretation of this licence;
- (b) words importing the singular include the plural and vice versa;
- (c) words importing a gender include any gender;
- (d) an expression importing a natural person includes any company, partnership, trust, joint venture, association, corporation or other body corporate and any governmental agency;
- (e) a reference to any statute, regulation, proclamation, order in council, ordinance or bylaw includes all statutes, regulations, proclamations, orders in council, ordinances or by-laws varying, consolidating, re-enacting, extending or replacing them and a reference to a statute includes all regulations, proclamations, orders in council, ordinances, by-laws and determinations issued under that statute;
- (f) a reference to a person includes that person's executors, administrators, successors, substitutes (including, without limitation, persons taking by novation) and permitted assigns;
- (g) a reference to a document or a provision of a document includes an amendment or supplement to, or replacement or novation of, that document or that provision of that document;
- (h) an event which is required under this licence to occur on or by a stipulated day which is not a **business day** may occur on or by the next **business day**.

ANNEXURE

Part A – Services

Provision of the operation of 32 Siemens 3.2 MW (SWT-3.2-113) wind turbine electricity generators with a total combined maximum output capacity capped at 100 MW.

Part B – Map of area

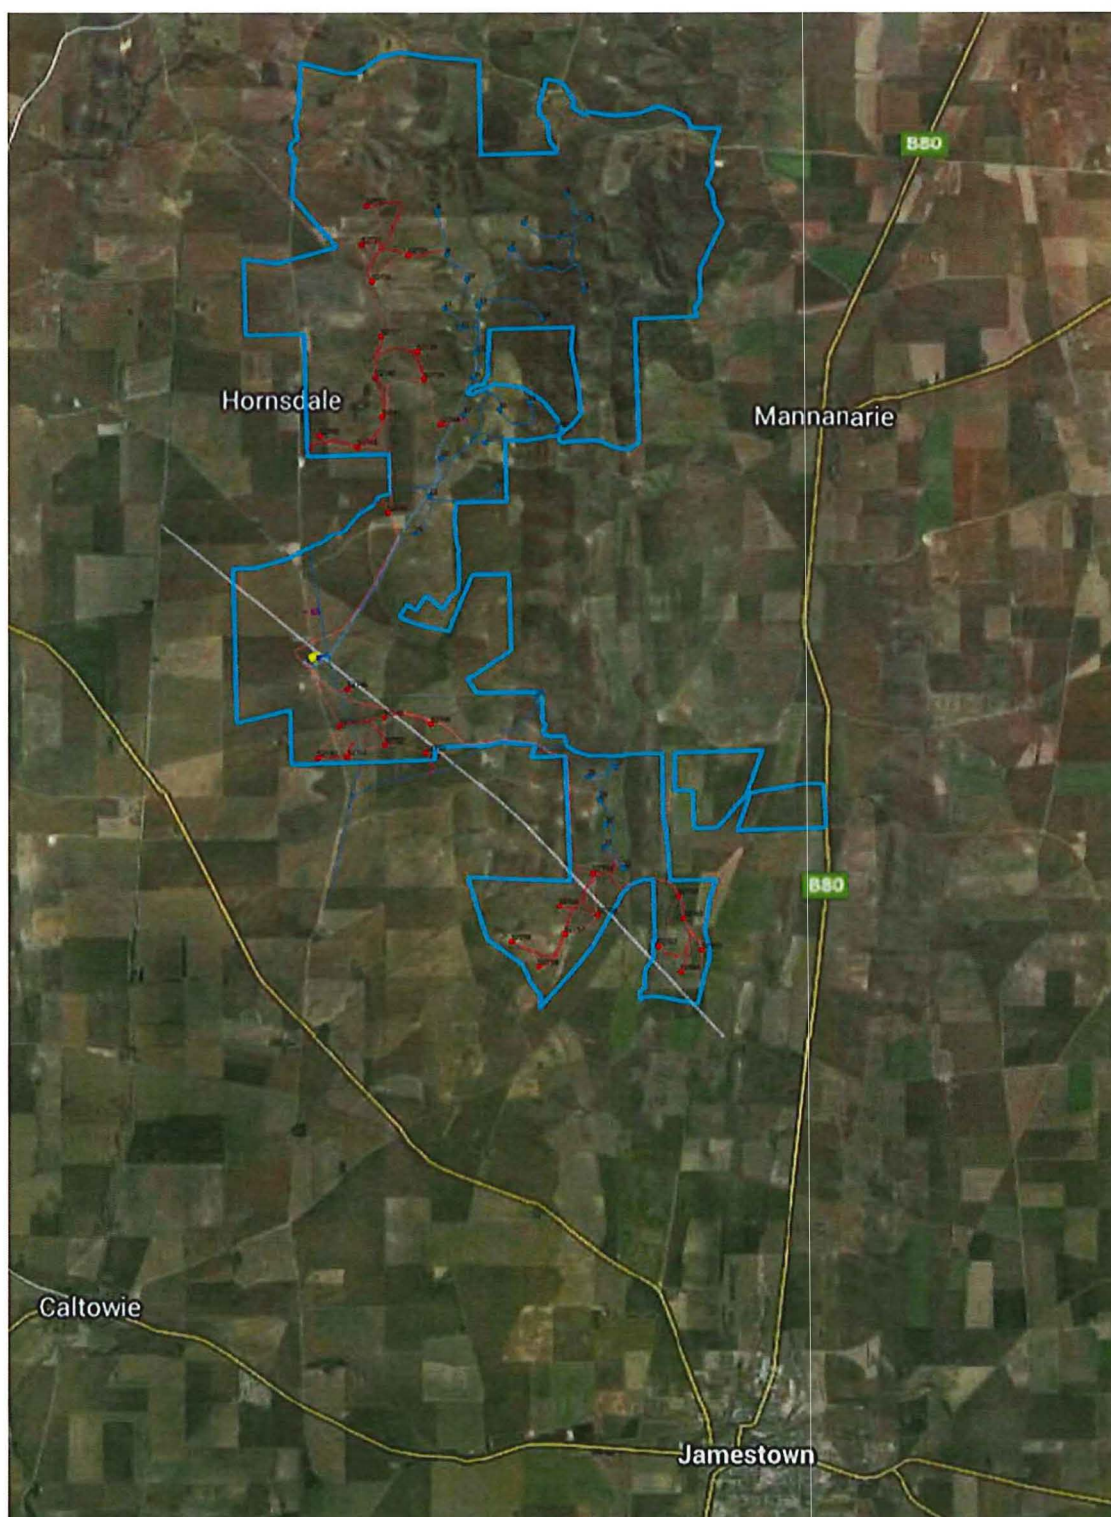



The Essential Services Commission of South Australia

Level 1, 151 Pirie Street Adelaide SA 5000

GPO Box 2605 Adelaide SA 5001

T 08 8463 4444

E escosa@escosa.sa.gov.au | W www.escosa.sa.gov.au